




metacaulk®

PILLOW-CW-9
Wall Penetration
up to: 4 Hour Rating

System No.
CAJ4049

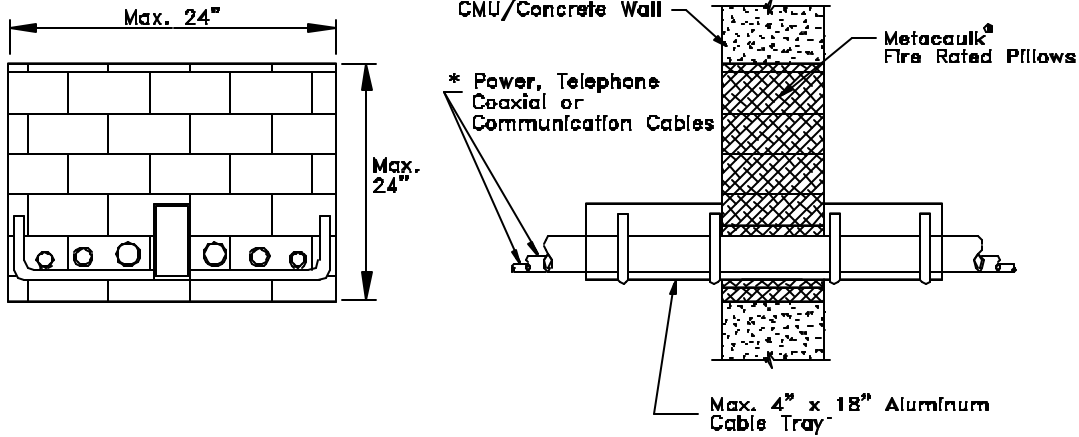

SYSTEM CONFIGURATION INFORMATION																	
METACAULK® PRODUCT(S)			PENETRATING ITEM(S)			HOLE SIZE		ANNULAR SPACING			ADDITIONAL INSTALLATION MATERIALS AND AIDS			BACKING MATERIAL		ASTM E 814 RATING	
PILL MAT'L	MIN. THICK.	OTHER	TYPE	SIZE	INSULATION	MAX.	MIN.	MAX.	WIRE MESH	STEEL SLEEVE	OTHER	TYPE	DEPTH	T	F		
Pillow	full wall	none	Power, Telephone, Coaxial, Communication cables	Max. fill 40% cross-section of areas	none	24" x 24"	3"	10"	none	none	none	none	N/A	N/A	4		

* Cable tray fill is comprised of power, telephone coaxial or communication cables.

INSTALLATION INSTRUCTIONS

These instructions are for the installation of through-penetration fire stop system PILLOW-CW-9 in minimum 7 5/8 inch thick lightweight or normal weight (100-150pcf) walls or concrete block (CMU) walls as listed by Underwriters Laboratories Inc. Refer to above drawings and System Configuration Information for component details.

Step Procedure

1. Install Metacaulk® Fire Rated Pillows by tightly packing bags with 9" dimension parallel with wall thickness between hole edges, cable tray, tubing and cables.
2. If needed, apply a 1/2" depth of Metacaulk® 1000 on mineral wool if irregular area exists that are not able to be filled with pillows.

JOB NAME:

ARCHITECT:

CUSTOMER:

CUSTOMER ORDER NO:

CONTRACTOR:

REPRESENTATIVE:

REPRESENTATIVE ORDER NO:

RECTORSEAL
2601 SPENWICK HOUSTON, TEXAS 77055

REVISION NUMBER: 100699

SHEET NUMBER: OF