


### System No. C-AJ-2119

May 08, 1998

F Rating — 3 Hr

T Rating — 2 Hr

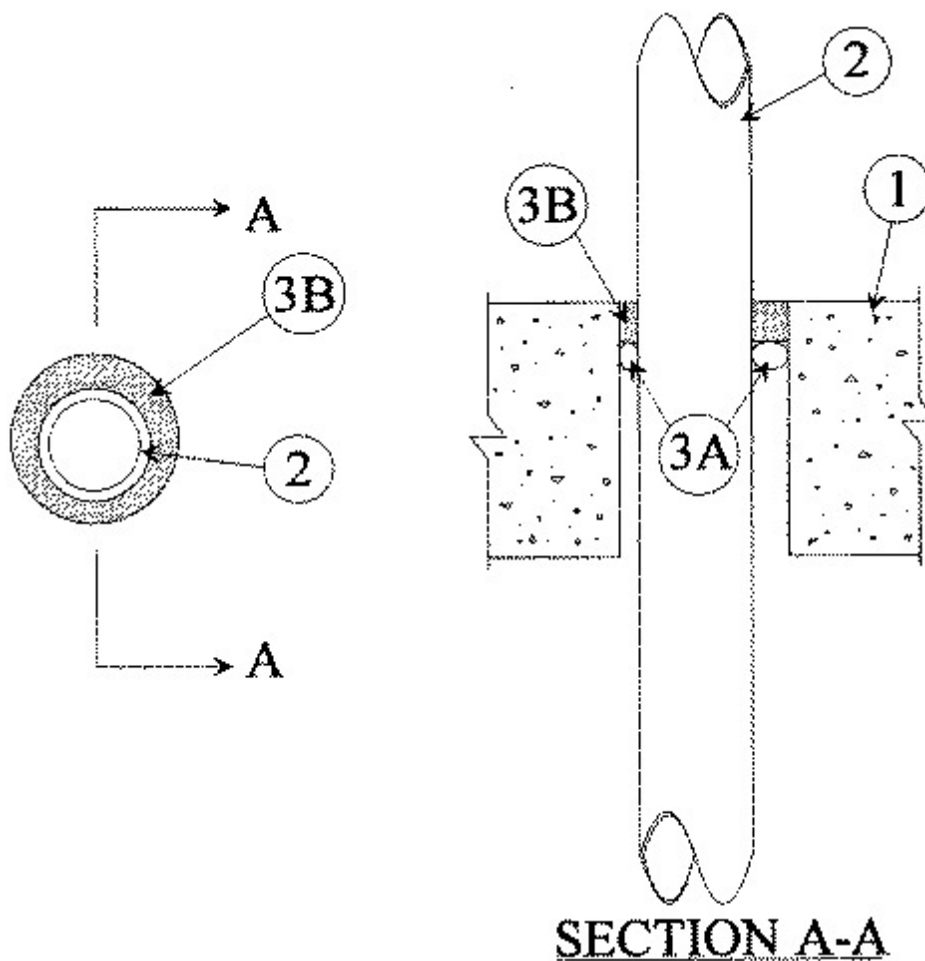

1. **Floor or Wall Assembly** — Min 4-1/2 in. thick reinforced lightweight or normal weight (100-150 pcf) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks\***. Max diam of opening is 2 in.

See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.

2. **Through Penetrant** — One nonmetallic pipe or tube to be installed either concentrically or eccentrically within the firestop system. The annular space to be min 5/16 in. to max 3/8 in. Pipe or tube to be rigidly supported on both sides of floor or wall assembly. The following type and sizes of pipe may be used.

A. **Polyvinyl Chloride (PVC) Pipe** — Nom 1 in. diam (or smaller) Schedule 40 PVC pipe for use in closed (process or supply) or vented (drain, waste and vent) piping systems.

B. **Chlorinated Polyvinyl Chloride (CPVC) Pipe** — Nom 1 in. diam (or smaller) SDR 17 CPVC pipe for use in closed (process or supply) piping systems.

C. **Crosslinked Polyethylene (PEX) Tubing** — Nom 1 in. diam (or smaller) SDR 9 PEX tube for use in closed (process or supply) piping systems.

3. **Firestop System** — The firestop system shall consist of the following:

A. **Packing Material** — (Optional) — Foam backer rod firmly packed into opening as a permanent form. Packing material to be recessed from top surface of floor or from both surfaces

of wall as required to accommodate the required thickness of fill material.

**B. Fill, Void or Cavity Material\*** — Caulk — Min 1/2 in. thickness of fill material applied within the annulus, flush with top surface of floor or with both surfaces of wall.

**RECTORSEAL** — Metacaulk 1000

\*Bearing the UL Classification Mark