




System No. C-AJ-2552

September 22, 2005

F Rating — 2 Hr

T Rating — 1 Hr

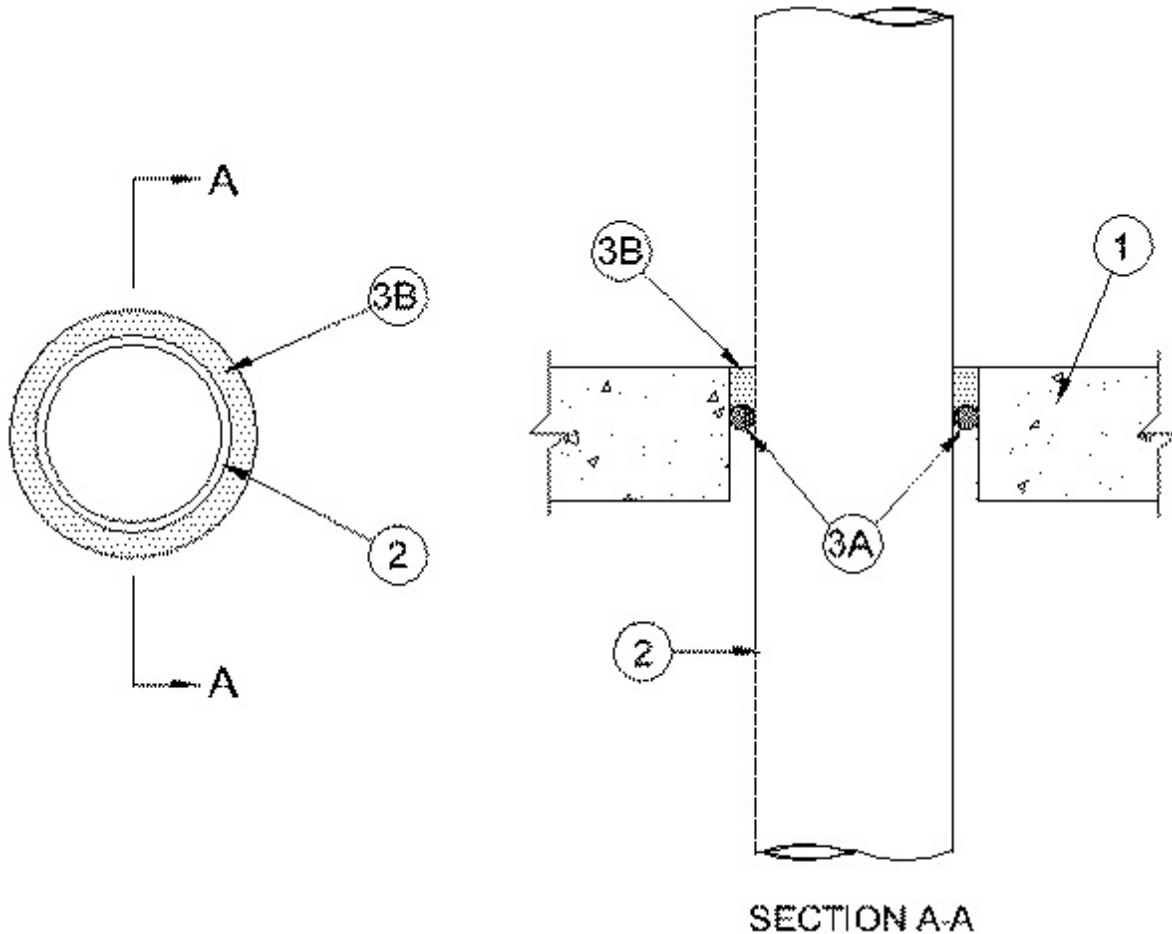

1. Floor or Wall Assembly — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks***. Floor may also be constructed of any min 6 in. (152 mm) thick UL Classified hollow-core **Precast Concrete Units***. Max diam of opening is 3 in. (76 mm).

See **Concrete Blocks** (CAZT) and Precast Concrete Units (CFTV) categories in the Fire Resistance Directory for names of manufacturers.

2. Nonmetallic Pipe — One nonmetallic pipe to be centered within the firestop system. A nom annular space of 9/16 in. (14 mm) is required within the firestop system. Pipe to be rigidly supported on both sides of floor or wall assembly. The following types and sizes of nonmetallic pipes may be used:

A. Polyvinyl Chloride (PVC) Pipe — Nom 1-1/2 in. (38 mm) diam (or smaller) Schedule 40 PVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.

B. Chlorinated Polyvinyl Chloride (CPVC) Pipe — Nom 1-1/2 in. (38 mm) diam (or smaller) SDR 13.5 CPVC pipe for use in closed (process or supply) piping systems.

3. Firestop System — The firestop system shall consist of the following:

A. Packing Material — (Optional) — Foam backer rod firmly packed into opening as a permanent form. Packing material to be recessed from top surface of solid concrete floor, or

from both surfaces of wall or hollow-core floor to accommodate the required thickness of fill material.

B. Fill, Void or Cavity Material* - Caulk — Min 3/4 in. (19 mm) thickness of fill material applied within the annulus, flush with top surface of solid concrete floor, or with both surfaces of wall or hollow-core floor.

RECTORSEAL — Metacaulk 350i

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.