




### System No. W-J-0004

November 05, 1997

F Rating — 2 Hr

T Rating — 2 Hr

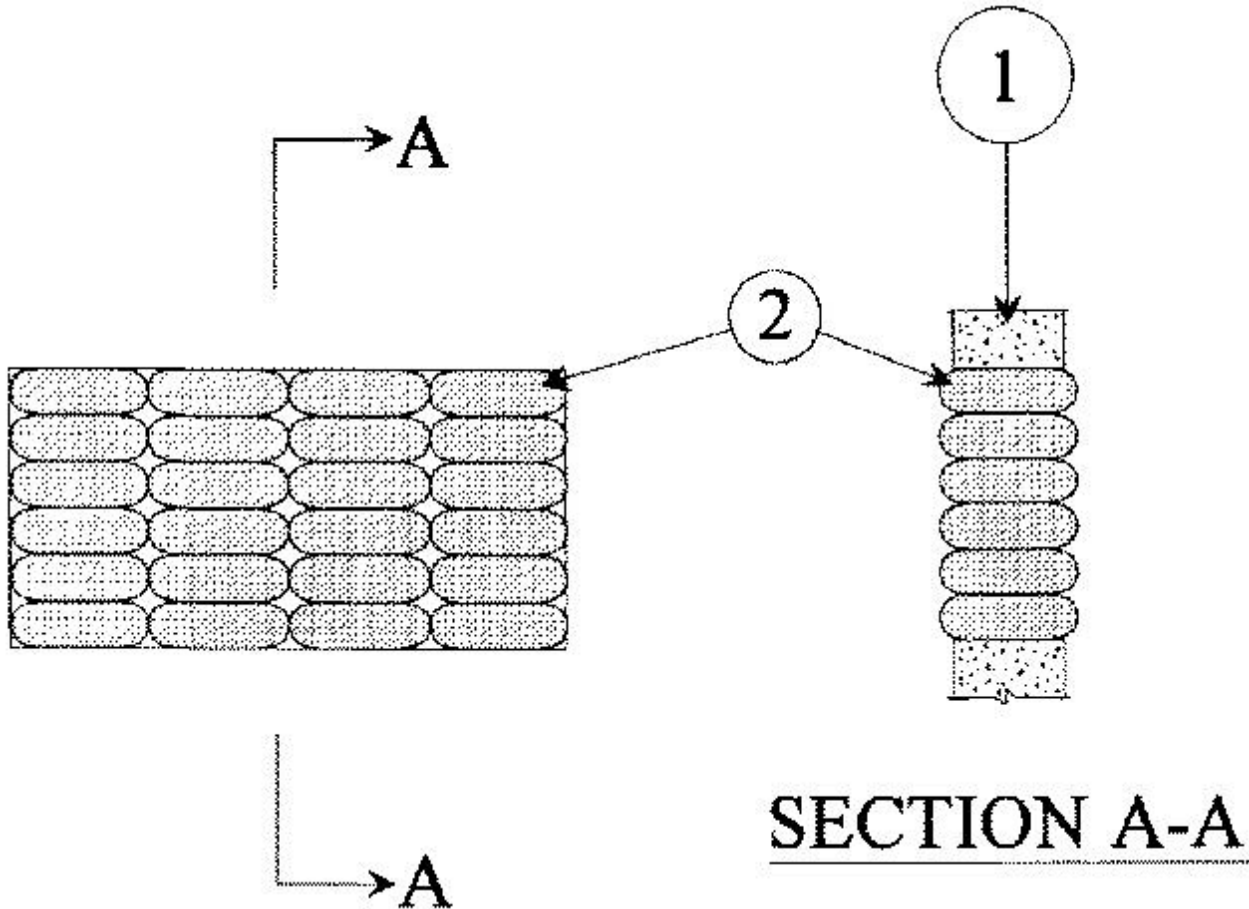

1. **Wall Assembly** — Min 5 in. thick reinforced lightweight or normal weight (100-150 pcf) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks\***. Max area of opening is 288 sq in. with max dimension of 24 in.

See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.

2. **Fill, Void or Cavity Material\*** — **Pillows** — Max 6 in. long by 9 in. wide by 2 in. thick plastic covered intumescent pillows tightly packed into opening. Pillows to be installed horizontally within the opening and centered within walls.

**RECTORSEAL** — Metacaulk Pillows

\*Bearing the UL Classification Mark