




System No. W-L-7208

March 06, 2012

| ANSI/UL1479 (ASTM E814) | CAN/ULC S115 |
|-------------------------------------|--------------------------------------|
| F Ratings — 1 and 2 Hr (See Item 1) | F Ratings — 1 and 2 Hr (See Item 1) |
| T Rating — 0 Hr | FT Rating — 0 Hr |
| | FH Ratings — 1 and 2 Hr (See Item 1) |
| | FTH Rating — 0 Hr |

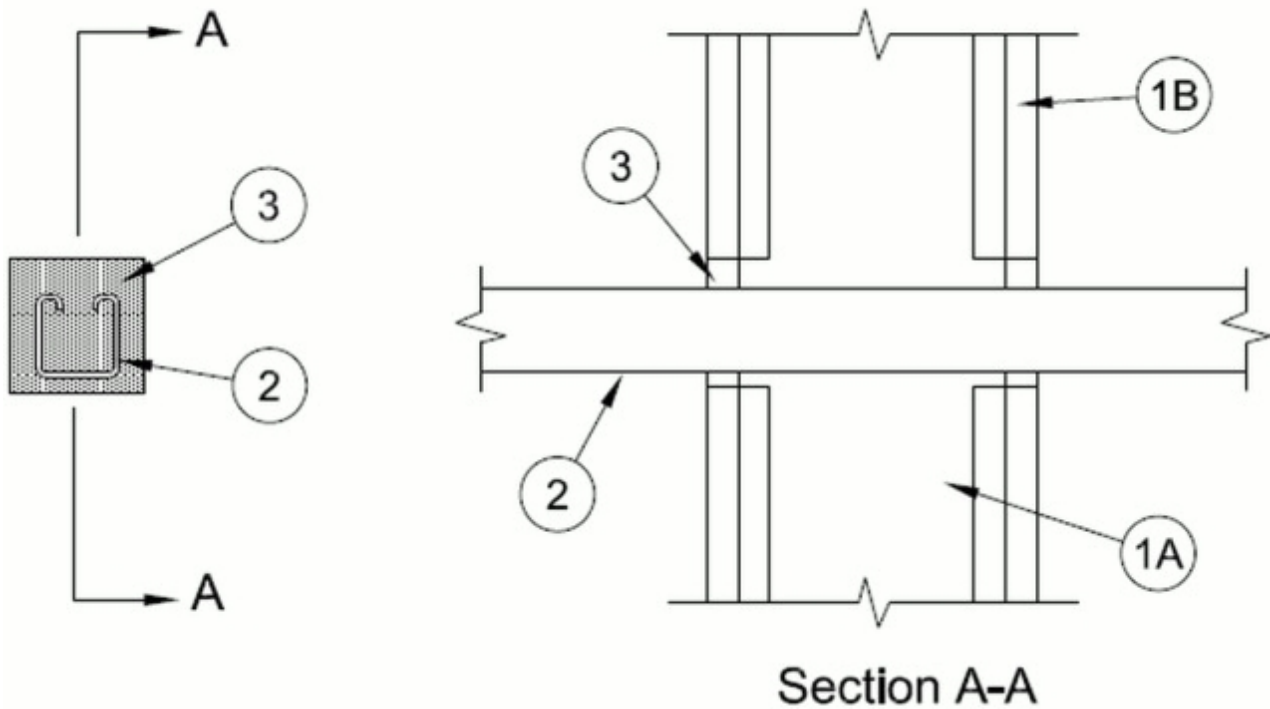

1. Wall Assembly — The 1 or 2 hr fire rated gypsum board/stud wall assembly shall be constructed of the materials and in the manner specified in the individual U300, U400, V400 or W400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:

A. Studs — Wall framing may consist of either wood studs or steel channel studs. Wood studs to consist of nom 2 by 4 in. (51 by 102 mm) lumber spaced max 16 in. (406 mm) OC. Steel studs to be min 2-1/2 in. (64 mm) wide and spaced max 24 in. (610 mm) OC.

B. Gypsum Board* — One or two layers of gypsum board, as specified in the individual Wall and Partition Design. Max diam of opening is 3-3/8 in. (86 mm). Max area of rectangular opening is 16.5 sq in. (106 cm²) with max dimension of 5 in. (127 mm).

The hourly F and FH Ratings of the firestop system are equal to the hourly fire rating of the wall assembly in which it is installed.

2. Through Penetrants — One metallic strut, cable or rod service support to be installed within the firestop system. An annular space of min 1/8 in. (3 mm) to max 7/8 in. (22 mm) is required within the firestop system. Strut, cable or rod service support to be rigidly supported on both sides of wall assembly. The strut, cable or rod service support may be installed at an angle not greater than 45 degrees from the perpendicular. The following types and sizes of metallic strut, cable or rod service support may be used:

A. **Steel Strut** — Max 1-5/8 by 1-5/8 in. (41 by 41 mm) channel strut formed from min 0.105 in. (2.7 mm) thick galv or painted steel.

B. **Steel Strut** — Max 3-1/4 by 1-5/8 in. (83 by 41 mm) H strut formed from min 0.105 in. (2.7 mm) thick galv or painted steel.

C. **Cable** — Max 3/8 in. (9.5 mm) diam unjacketed galv steel cable.

D. **Threaded Rod** — Max 5/8 in. (16 mm) diam galv steel threaded rod.

3. **Fill, Void or Cavity Material* - Caulk or Sealant** — Min 5/8 in. (16 mm) thickness of fill material applied within the annulus and within the channel struts, flush with both surfaces of wall.

RECTORSEAL — Metacaulk 1000, Metacaulk MC 150+, Biostop 500+, Biostop BF 150+, FlameSafe FS900+ or FlameSafe FS 1900

*Bearing the UL Classification Mark