

March 18, 2005

RectorSeal  
Ms. Eva Ackerman  
2601 Spenwick Drive  
Houston TX 77055

Our Reference: File R14546 / Project 05NK06823

Subject: Accelerated Aging and High Humidity Conditioning of RectorSeal  
Intumescent Products

Dear Ms. Ackerman:

This is to advise you that we have completed the testing of your Metacaulk 1000 Caulk, Metacaulk Wrap Strip, Metacaulk Pipe Collars, Biostop 500+ Caulk, Biostop Wrap Strip and Biostop Pipe Collars in accordance with the new requirements for accelerated aging and high humidity exposures outlined in our February 1, 2002 letter.

The results of tests for all of the products were in compliance with the requirements contained in Paragraphs 7.1 through 7.5 of the Third Edition of the Standard, *Fire Tests of Through-Penetration Firestops*, ANSI/UL 1479, issued May 23, 2003. These requirements have an effective date of May 23, 2006.


If you have any questions, please contact the writer.

Very truly yours,



RICHARD N. WALKE (Ext. 43084)  
Staff Engineer  
Fire Protection Division

Reviewed by:

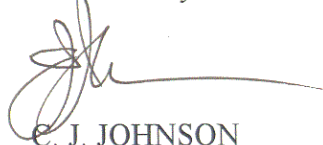

E. J. JOHNSON  
Lead Engineering Associate  
Fire Protection Division

